



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION
NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/economy

Huntsman Building Solutions
3315 East Division Street
Arlington, TX 76011

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER - Product Control Section to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein and has been designed to comply with the Florida Building Code including the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: FOAM-LOK LPA 2800-4G over Wood Decks.

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA No. 23-1018.14 and consists of pages 1 through 6.
The submitted documentation was reviewed by Jorge L. Acebo.

05/09/24



NOA No.: 24-0215.02
Expiration Date: 12/28/28
Approval Date: 05/09/24
Page 1 of 6

ROOFING COMPONENT APPROVAL

Category: Roofing
Sub-Category: Spray Applied Polyurethane Roof System
Materials: Polyurethane
Deck Type: Wood
Maximum Design Pressure: -90 psf.

TRADE NAMES OF PRODUCTS MANUFACTURED OR LABELED BY APPLICANT:

<u>Product</u>	<u>Dimensions</u>	<u>Test Specifications</u>	<u>Product Description</u>
FOAM-LOK LPA 2800-4G [R Formulation] Regular Blend	2.8 lbs/ft ³ density	TAS 110	A closed cell polyurethane spray applied foam that utilizes an EPA approved fourth generation blowing agent specifically designed a high performance, fully adhered roofing system.
FOAM-LOK LPA 2800-4G [S Formulation] Summer Blend	2.8 lbs./ft ³ density	TAS 110	A closed cell polyurethane spray applied foam that utilizes an EPA approved fourth generation blowing agent specifically designed a high performance, fully adhered roofing system.
THERMO-FLEX 1500HT Elastomeric Roof Coating	5, 55 and 275 gallons	ASTM D6083	A high solids thixotropic, acrylic elastomeric coating uniquely formulated for the protection of polyurethane foam insulation coating.
THERMO-SIL PRO 9600 High Solids Silicone Coating	1, 5, 55, and 275 gallons.	ASTM D6694	THERMO-SIL PRO 9600 High Solids Silicone Coating is a solvent-free, high solids, single-component, silicone moisture cured roof coating.



NOA No.: 24-0215.02
Expiration Date: 12/28/28
Approval Date: 05/09/24
Page 2 of 6

TRADE NAMES OF PRODUCTS MANUFACTURED BY OTHERS:

<u>Product</u>	<u>Dimensions</u>	<u>Test Specifications</u>	<u>Product Description</u>	<u>Manufacturer</u>
Any Miami-Dade County Approved Roof Coating	N/A	As Required by Miami-Dade County PCA	Roof coating for application over polyurethane spray applied foam.	Generic. (with current PCA)
Securock Gypsum-Fiber Roof Board	½” x 4’ x 8’	ASTM C1278	A rigid, gypsum-based board stock for use as overlayment, underlayment or bonding surface.	USG Corporation
3 in. Ribbed Galvalume Plate	3” round	TAS 114 TAS 117	Round galvalume plated steel stress plate with reinforcing ribs for use with OMG fasteners.	OMG, Inc
#12 Standard Roofgrip Fastener	#12 x 8" Max. Length #3 Phillips head	TAS 114 TAS 117	Phillips head, modified buttress thread, carbon steel fastener for use in steel or wood decks.	OMG, Inc
Drill-Tec XHD Fastener	#15 x 16" Max. Length #3 Phillips head	TAS 114 TAS 117	Phillips head, modified buttress thread, carbon steel fastener for use in steel or wood decks.	GAF

EVIDENCE SUBMITTED:

<u>Test Agency</u>	<u>Test Identifier</u>	<u>Test Name/Report</u>	<u>Date</u>
PRI Construction Materials Technologies, LLC	2411T0030	TAS 110	12/13/23
	2411T0004	ASTM D6083	08/30/22
	2411T0025	TAS 110/ TAS 114-D	11/30/23
	TRS-145-02-01	ASTM D 6694	03/09/18
Intertek	P6200.01-106-18 R1	TAS 110	12/26/23
	P9913.01-106-19 R2	TAS 110	12/26/23
	P6200.05-109-18 R3	TAS 110/ TAS 114-J	12/18/23
UL LLC	R14353	UL 790	10/16/23



APPROVED ASSEMBLIES:

Deck Type 1I:	Wood, Insulated
Deck Description:	19/32” or greater plywood, CAT PS 1-19, Grade C-D, Exposure 1, 40/20 span rated, 4 ply plywood or wood plank.
System Type B(1):	Sprayed polyurethane foam covered with an Approved Miami-Dade County roof coating installed over a mechanically fastened rigid insulation board.
Deck Attachment:	Attached to structural supports spaced a maximum of 24” o.c. In accordance with applicable Building Code, but in no case shall it be less than: 0.113” x 2-3/8” Ring shank nails spaced 6” o.c. at the field and perimeter of the plywood sheet. The above attachment method must be in addition to any existing attachment.

All General and System Limitations apply.

One layer of the following insulation.

<u>Insulation Layer</u>	<u>Insulation Fasteners</u>	<u>Fastener Density/ft²</u>
Securock Gypsum-Fiber Roof Board Minimum .5” thick	#12 Standard Roofgrip Fastener with 3” Ribbed Galvalume Metal Plate	1:2 16 fasteners per 4’ x 8’ board

Note: Insulation panels listed are minimum sizes and dimensions; if larger panels are used, the number of fasteners shall be increased maintaining the same fastener density. Please refer to Roofing Application Standard RAS 117 for insulation attachment.

Surface Preparation: All surfaces shall be free of moisture, dust, debris, oils, tars, grease or other materials that will as recommended by Huntsman Building Solutions impair adhesion of the polyurethane foam to the insulation board.

Polyurethane Foam Application: The **FOAM-LOK LPA 2800-4G [R Formulation]** polyurethane foam shall be applied uniformly over the entire surface of the insulation at the specified thickness in compliance with the requirements set forth in Roofing Application Standard RAS 109, But in no case shall it be less than 2”. The sprayed polyurethane foam shall be feathered at the edges to produce a smooth transition.

Protective Coating Application: Apply THERMO-FLEX 1500HT Elastomeric Roof Coating or THERMO-SIL PRO 9600 High Solids Silicone Coating or another Miami-Dade County approved roof coating for use with SPUF with a current NOA applied in accordance with the guidelines listed in the NOA.

Polyurethane foam surface shall be free of moisture, dust, debris, oils, tars, grease or other materials that will as recommended by Huntsman Building Solutions. impair adhesion of the protective coverings. Any damage or defects to the polyurethane foam surface shall be repaired prior to the coating application. The coating shall be applied the same day as the foam when possible. If more than 72 hours elapse prior to the application of the coatings, the polyurethane foam shall be inspected for UV degradation.

Maximum Design Pressure: -75 psf. (See General Limitation #7.)



NOA No.: 24-0215.02
Expiration Date: 12/28/28
Approval Date: 05/09/24
Page 4 of 6

Deck Type 1I:	Wood, Insulated
Deck Description:	19/32" or greater plywood, CAT PS 1-19, Grade C-D, Exposure 1, 40/20 span rated, 4 ply plywood or wood plank.
System Type B(2):	Sprayed polyurethane foam covered with an Approved Miami-Dade County roof coating installed over a mechanically fastened rigid insulation board.
Deck Attachment:	Attached to structural supports spaced a maximum of 24" o.c. In accordance with applicable Building Code, but in no case shall it be less than: 0.113" x 2-3/8" Ring shank nails spaced 6" o.c. at the field and perimeter of the plywood sheet. The above attachment method must be in addition to any existing attachment.

All General and System Limitations apply.

One layer of the following insulation.

<u>Insulation Layer</u>	<u>Insulation Fasteners</u>	<u>Fastener Density/ft2</u>
Securock Gypsum-Fiber Roof Board Minimum .5" thick	Drill-Tec XHD Fastener #15 x 3" with 3" Ribbed Galvalume Metal Plate	1:2 16 fasteners per 4' x 8' board

Note: Insulation panels listed are minimum sizes and dimensions; if larger panels are used, the number of fasteners shall be increased maintaining the same fastener density. Please refer to Roofing Application Standard RAS 117 for insulation attachment.

Surface Preparation: All surfaces shall be free of moisture, dust, debris, oils, tars, grease or other materials that will as recommended by Huntsman Building Solutions impair adhesion of the polyurethane foam to the insulation board.

Polyurethane Foam Application: The **FOAM-LOK LPA 2800-4G [S Formulation]** polyurethane foam shall be applied uniformly over the entire surface of the insulation at the specified thickness in compliance with the requirements set forth in Roofing Application Standard RAS 109, But in no case shall it be less than 2". The sprayed polyurethane foam shall be feathered at the edges to produce a smooth transition.


Protective Coating Application: Apply THERMO-FLEX 1500HT Elastomeric Roof Coating or THERMO-SIL PRO 9600 High Solids Silicone Coating or another Miami-Dade County approved roof coating for use with SPUF with a current NOA applied in accordance with the guidelines listed in the NOA.

Polyurethane foam surface shall be free of moisture, dust, debris, oils, tars, grease or other materials that will as recommended by Huntsman Building Solutions. impair adhesion of the protective coverings. Any damage or defects to the polyurethane foam surface shall be repaired prior to the coating application. The coating shall be applied the same day as the foam when possible. If more than 72 hours elapse prior to the application of the coatings, the polyurethane foam shall be inspected for UV degradation.

Maximum Design Pressure: -90 psf. (See General Limitation #7.)



TABLE 1
AMBIENT HUMIDITY APPLICATION LIMITS
SPRAYED POLYURETHANE FOAM

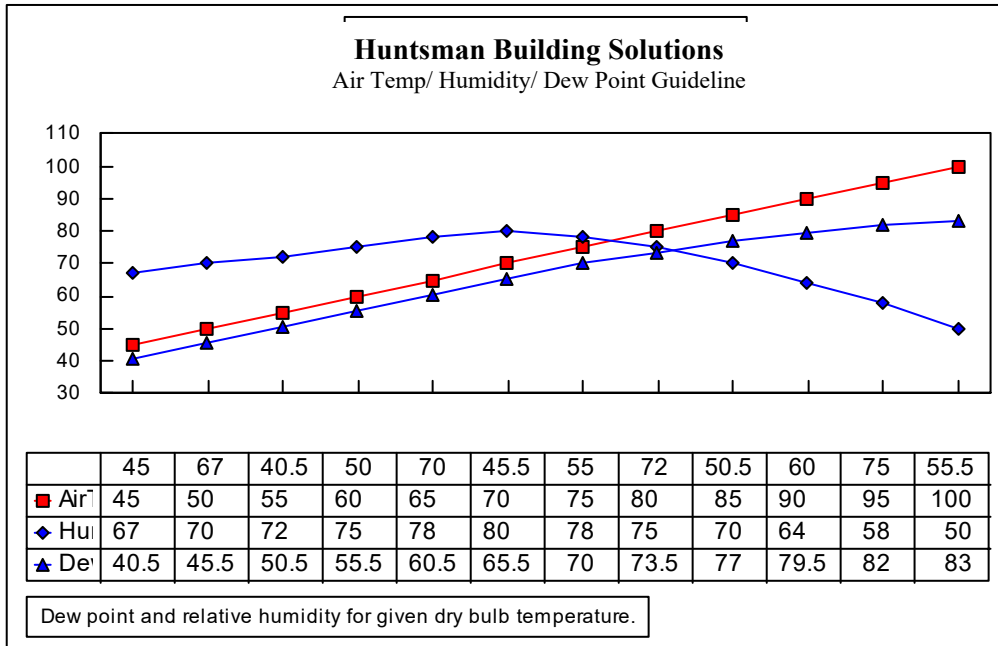

GENERAL LIMITATIONS:

1. Fire classification is not part of this acceptance, refer to a current Approved Roofing Materials Directory for fire ratings of this product
2. Spray polyurethane foam shall not be sprayed when ambient temperature is within 5 degrees of the dew point. Ambient humidity applications limits shall be as listed in Table 1 herein. The contractor shall monitor and record environmental conditions in the Job Log in compliance with RAS 109. Job Log shall be maintained at the job site and accessible to The Building Official.
3. Flashings and waterproof coverings for expansion joints shall be of compatible materials and in accordance with Huntsman Building Solutions. published literature.
4. Miscellaneous materials such as adhesives, elastomeric caulking compounds, metal, vents and drains shall be a composite part of the roof system and shall be compatible with the foam and coating.
5. All standard panel sizes are acceptable for mechanical attachment. When applied in approved asphalt, panel size shall be 4' x 4' maximum.
6. Fastener spacing for insulation attachment is based on a Minimum Characteristic Force (F') value of 275 lbf., as tested in compliance with Testing Application Standard TAS 105. If the fastener value, as field-tested, are below 275 lbf. Insulation attachment shall not be acceptable.
7. Perimeter and corner areas shall comply with the enhanced uplift pressure requirements of these areas. Fastener densities shall be increased for both insulation and base sheet as calculated in compliance with Roofing Application Standard RAS 117. Calculations prepared, signed and sealed by a Florida registered Professional Engineer, Registered Architect, or Registered Roof Consultant **(When this limitation is specifically referred within this NOA, General Limitation #9 will not be applicable.)**
8. All attachment and sizing of perimeter nailers, metal profile, and/or flashing termination designs shall conform with Roofing Application Standard RAS 111 and applicable wind load requirements.
9. The maximum designed pressure limitation listed shall be applicable to all roof pressure zones (i.e. field, perimeters, and corners). Neither rational analysis, nor extrapolation shall be permitted for enhanced fastening at enhanced pressure zones (i.e. perimeters, extended corners and corners). **(When this limitation is specifically referred within this NOA, General Limitation #7 will not be applicable.)**

END OF THIS ACCEPTANCE

