



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/economy

NOTICE OF ACCEPTANCE (NOA)

O'Hagin Manufacturing, LLC
210 Classic Court, Suite #100
Rohnert Park, CA 94928

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER - Product Control Section to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code including the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: O'Hagin's Climate Resistant Series (CRS) Low Profile Tapered Vent for Metal Roofs

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of pages 1 through 5.
The submitted documentation was reviewed by Alex Tigera.

06/20/24



NOA No.: 24-0430.03
Expiration Date: 06/20/29
Approval Date: 06/20/24
Page 1 of 5

ROOFING ASSEMBLY APPROVAL

Category: Roofing
Sub-Category: Ventilation
Materials: 26 ga. Steel; 0.032" Aluminum; 16 oz. Copper
Minimum Slope: 2:12

TRADE NAMES OF PRODUCTS MANUFACTURED OR LABELED BY APPLICANT

| <u>Product</u> | <u>Dimensions</u> | <u>Test Specification</u> | <u>Product Description</u> |
|---|---|----------------------------------|---|
| O'Hagin's Climate Resistant Series (CRS) Low Profile Tapered Vent for Metal Roofs | Length: 27" Width: 27" Height: 2-5/8" | TAS 100(A) | Galvanized metal, aluminum, or copper static roof vent. |

MANUFACTURING LOCATIONS

1. Lakeland, FL.
2. Rohnert Park, CA

EVIDENCE SUBMITTED

| <u>Test Agency/Identifier</u> | <u>Name</u> | <u>Report</u> | <u>Date</u> |
|--------------------------------------|--------------------|----------------------|--------------------|
| Intertek | TAS 100(A) | Q3787.03-450-18 R1 | 01/05/24 |



NOA No.: 24-0430.03
Expiration Date: 06/20/29
Approval Date: 06/20/24
Page 2 of 5

APPROVED APPLICATIONS

| | |
|----------------------------------|--|
| Trade Name: | O'Hagin's Climate Resistant Series (CRS) Low Profile Tapered Vent for Metal Roofs |
| System Type A: | Mechanical attachment of vent for non-structural metal roof systems. |
| Slot: | Mark an 11" x 11" opening centered between layout lines as seen in Detail B . Set blade to thickness of sheathing and cut opening. Brush away sawdust and debris. |
| Installation: | See Detail B herein. |
| Ventilation Calculations: | See manufacturer's published literature for net free area |

GENERAL LIMITATIONS:


1. Refer to applicable building code for required ventilation.
2. The installation shall be applied in compliance with the manufacturer's current published application instruction and the requirements set forth in applicable building code.
3. O'Hagin's Climate Resistant Series (CRS) Low Profile Tapered Vent for Metal Roofs is approved to be installed over non-structural metal roofs only.
4. O'Hagin's Climate Resistant Series (CRS) Low Profile Tapered Vent for Metal Roofs shall not be installed on roof mean heights greater than 75 ft.
5. All products listed herein shall have a quality assurance audit in accordance with the Florida Building Code and Rule 61G20-3 of the Florida Administrative Code.
6. All approved products listed herein shall be labeled and shall bear the imprint or identifiable marking of the manufacturer's name or logo and following statement: "Miami-Dade County Product Control Approved" or the Miami-Dade County Product Control Seal as shown below.



NOA No.: 24-0430.03
Expiration Date: 06/20/29
Approval Date: 06/20/24
Page 3 of 5


DETAIL A

O'HAGIN'S CLIMATE RESISTANT SERIES (CRS) LOW PROFILE TAPERED VENT FOR METAL ROOFS

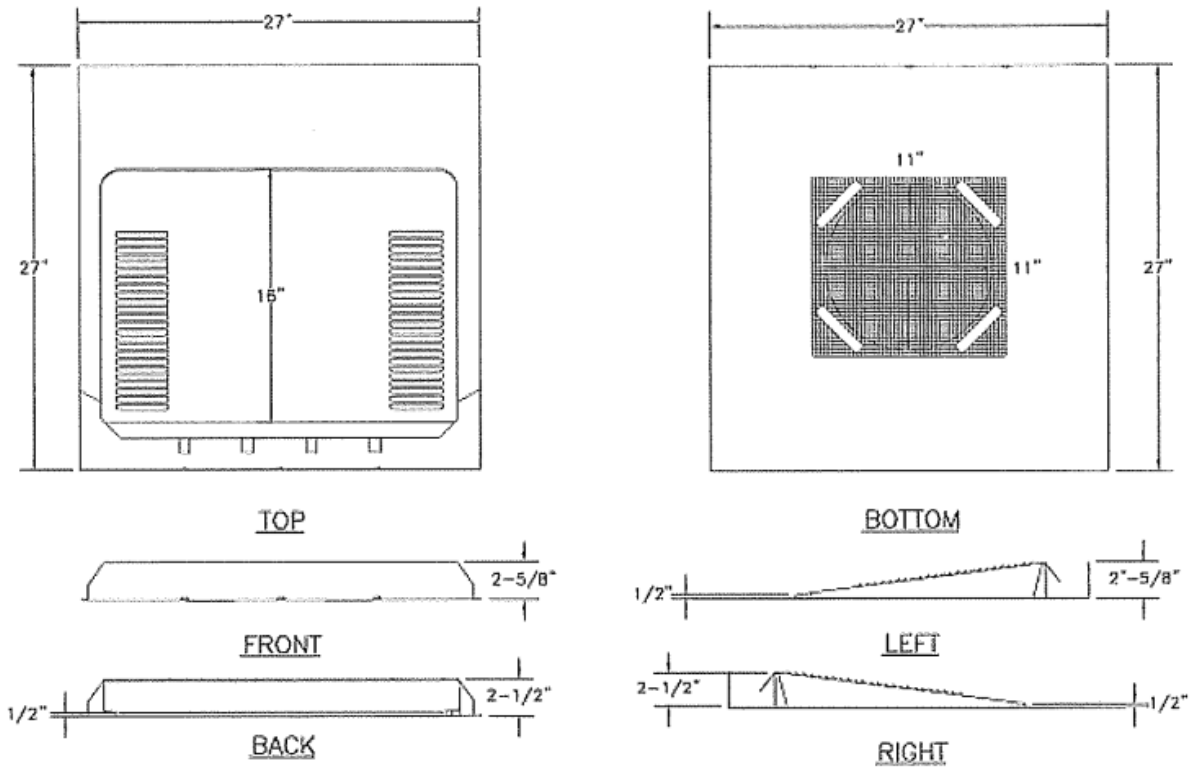

DETAIL B


O'HAGIN CLIMATE RESISTANT SERIES (CRS) ATTIC VENTS INSTALLATION INSTRUCTIONS FOR METAL ROOF APPLICATIONS

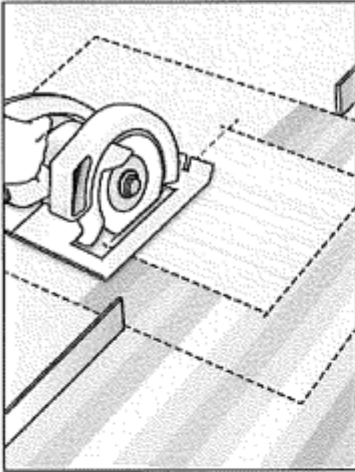


1. MARK & CUT the seam 19 inches apart, unfold cut seam and flatten to roof deck, continue this cut for 14 inches horizontally across the roof panel in opposite directions of the seam. **MARK** the outline of the vent for placement later and mark the 11 x 11 inch hole in roof panels 4 inches from the seam (half of the hole is removed from each roof panel). **CUT** the 11 x 11 inch opening through the roof sheathing, with blade set to thickness of roof sheathing.




2. SEAL by overlapping locally-approved Class A butyl tape around all four sides of wire mesh vent opening as well as the outer flange as shown above. No tape on upper flange of vent.

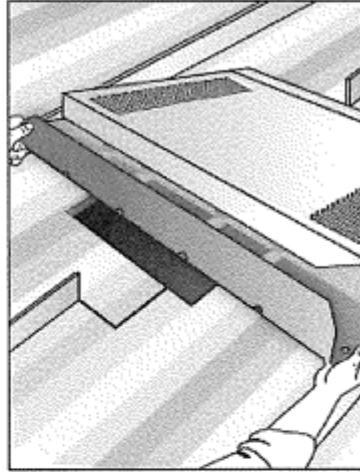

3. PLACE rear flange of vent through the 28 inch cut underneath the upper roof panels, using previously marked outline as a guide until the seam touches the rear lip of the vent cover. Lower vent directly over 11 x 11 inch hole on top of the roof panels, the front diverter should come in contact with lower seam. Apply locally-approved Class A butyl tape across the entire 28" cut where the roof panel overlaps the upper flange of the vent.

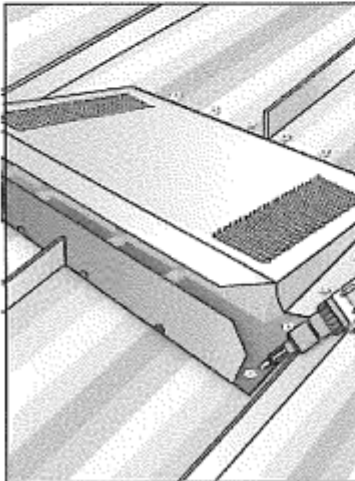

4. SECURE at 4" centers, using locally-approved metal roofing screws of sufficient length to penetrate sheathing.

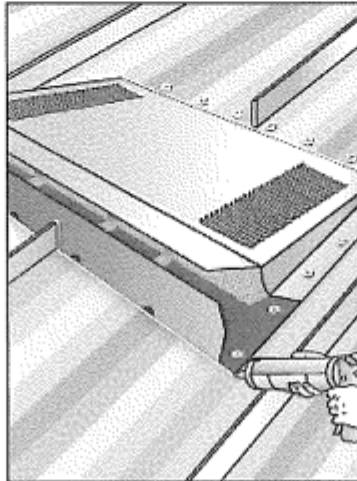

5. SEAL upper and lower seams and metal roof panels overlapping top vent flange and diverter on top of metal roof panels using Class A sealant.

GENERAL INSTRUCTION NOTES:

1. Class A materials should be used for best results.
2. Do not install vents below areas of concentrated water runoff, particularly if partially under, near, or adjacent to solar array installations. Placement assumes gutters are installed and are in good working order in all applicable areas.
3. Standard installation is at 3:12 pitch or greater.
4. All low vents (intake) shall be uniformly installed within the upper 1/3 of the attic, a minimum of 6 inches above attic insulation. The width of any eave overhang must be taken into consideration so, for example, the insulation does not block the attic vent opening.
5. All high vents (exhaust) shall be uniformly installed within the upper 1/3 of the attic, unless prevented by structural framing or other design limitations.
6. O'Hagin vents are designed to be part of a complete roofing system. Failure to properly install all components will negatively impact overall performance and will void warranty protection.

END OF THIS ACCEPTANCE