



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/economy

NOTICE OF ACCEPTANCE (NOA)

O'Hagin Manufacturing, LLC
210 Classic Court, Suite #100
Rohnert Park, CA 94928

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER - Product Control Section to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code including the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: O'Hagin's Climate Resistant Series (CRS) Low Profile Tapered Vent for Asphalt Shingle Roofs

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of pages 1 through 5.

The submitted documentation was reviewed by Alex Tigera.

06/27/24



NOA No.: 24-0430.04
Expiration Date: 06/20/29
Approval Date: 06/20/24
Page 1 of 5

ROOFING ASSEMBLY APPROVAL

Category: Roofing
Sub-Category: Ventilation
Materials: 26 ga. Steel; 0.032" Aluminum; 16 oz. Copper
Minimum Slope: 2:12

TRADE NAMES OF PRODUCTS MANUFACTURED OR LABELED BY APPLICANT

| <u>Product</u> | <u>Dimensions</u> | <u>Test Specification</u> | <u>Product Description</u> |
|---|---|----------------------------------|---|
| O'Hagin's Climate Resistant Series (CRS) Low Profile Tapered Vent for Asphalt Shingle Roofs | Length: 32" Width: 24" Height: 2-5/8" | TAS 100(A) | Galvanized metal, aluminum, or copper static roof vent. |

MANUFACTURING LOCATIONS

1. Lakeland, FL.
2. Rohnert Park, CA

EVIDENCE SUBMITTED

| <u>Test Agency/Identifier</u> | <u>Name</u> | <u>Report</u> | <u>Date</u> |
|--------------------------------------|--------------------|----------------------|--------------------|
| Intertek | TAS 100(A) | Q3787.02-450-18 R2 | 04/15/24 |



NOA No.: 24-0430.04
Expiration Date: 06/20/29
Approval Date: 06/20/24
Page 2 of 5

APPROVED APPLICATIONS

Trade Name: O'Hagin's Climate Resistant Series (CRS) Low Profile Tapered Vent for Asphalt Shingle Roofs

System Type A: Mechanical attachment of vent for shingle roofs.

Slot: Mark an 11" x 11" opening centered between layout lines as seen in Detail "B". Set blade to thickness of sheathing and cut opening. Brush away sawdust and debris.

Installation: Vents should be evenly spaced across slope of the roof.

Center vent in opening and set it in a ¼" thick bead of a Miami-Dade Approved Sealant with current NOA as seen in **Detail "B"**. Secure vent to the roof deck with 1-¼" x 3/8" galvanized ring shank roofing nails spaced approx. 4" o.c. and approx. 1" from the outside edge of the flange. Seal all nails with Miami-Dade Approved Sealant with current NOA.

After vent is secured install baffle in a ¼" thick bed of asphalt roofing cement, and secured with 1-¼" x 3/8" galvanized ring shank roofing nails spaced 8" o.c. for a total of 3 nails. Seal all nails with Miami-Dade Approved Sealant with current NOA.

Ventilation Calculations: See manufacturer's published literature for net free area

GENERAL LIMITATIONS:


1. Refer to applicable building code for required ventilation.
2. The installation shall be applied in compliance with the manufacturer's current published application instruction and the requirements set forth in applicable building code.
3. O'Hagin's Climate Resistant Series (CRS) Low Profile Tapered Vent for Asphalt Shingle Roofs is approved to be installed over asphalt shingles only.
4. O'Hagin's Climate Resistant Series (CRS) Low Profile Tapered Vent for Asphalt Shingle Roofs shall not be installed on roof mean heights greater than 75 ft.
5. All products listed herein shall have a quality assurance audit in accordance with the Florida Building Code and Rule 61G20-3 of the Florida Administrative Code.
6. All approved products listed herein shall be labeled and shall bear the imprint or identifiable marking of the manufacturer's name or logo and following statement: "Miami-Dade County Product Control Approved" or the Miami-Dade County Product Control Seal as shown below.



NOA No.: 24-0430.04
Expiration Date: 06/20/29
Approval Date: 06/20/24
Page 3 of 5


DETAIL A

O'HAGIN'S CLIMATE RESISTANT SERIES (CRS) LOW PROFILE TAPERED VENT FOR ASPHALT SHINGLE ROOFS

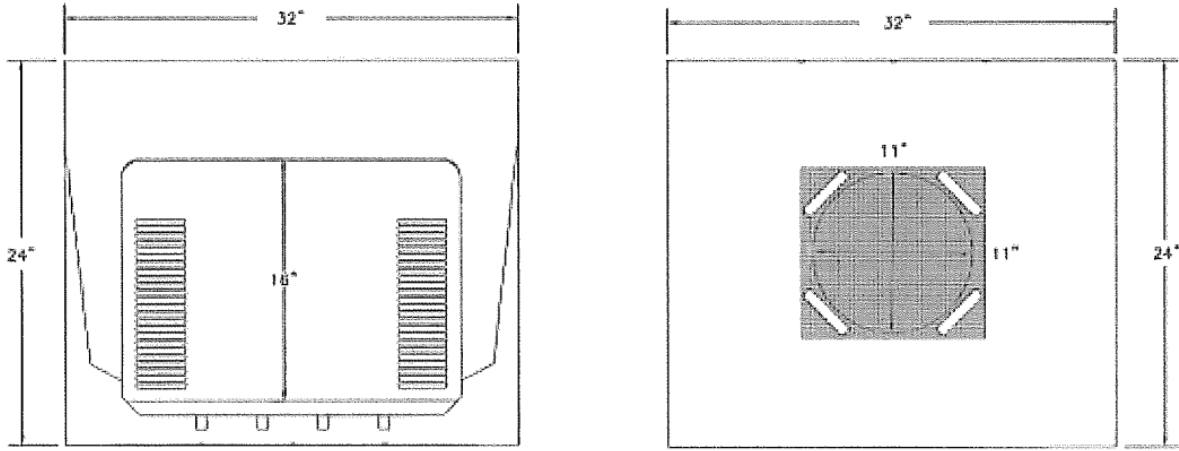

TOP

BOTTOM

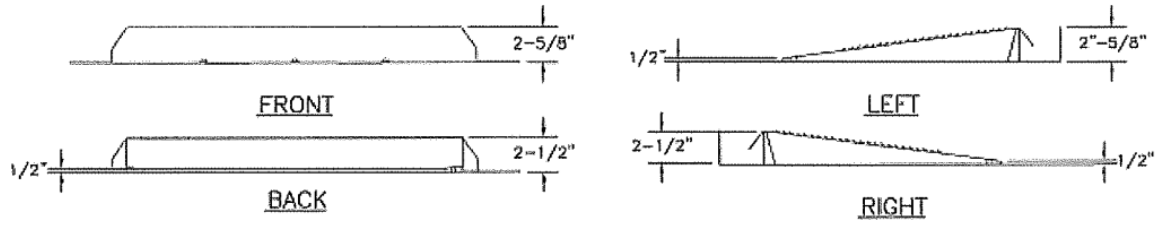

FRONT

BACK


LEFT

RIGHT




DETAIL B


O'HAGIN CLIMATE-RESISTANT SERIES (CRS) INSTALLATION INSTRUCTIONS FOR SHINGLE, SHAKE AND SLATE ROOF APPLICATIONS

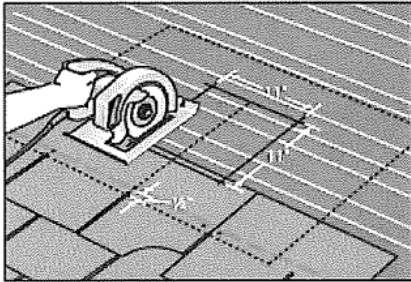


1. MARK & CUT Align front of vent 1/2 inch below nail line and mark outline of vent for placement later. Mark outline of 11 x 11 inch hole. With blade set to thickness of sheathing, cut hole in roof deck.

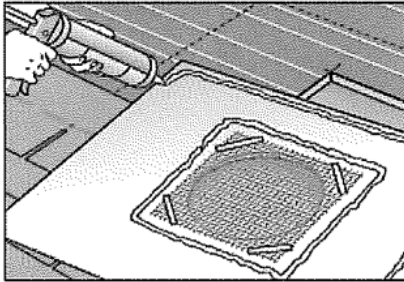


2. SEAL using a sufficient amount of locally-approved sealant around inner and outer flange.

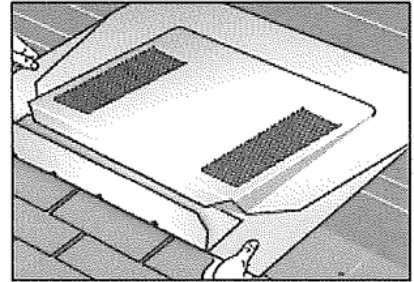


3. PLACE vent directly over 11 x 11 inch hole using previously marked outline as a guide.

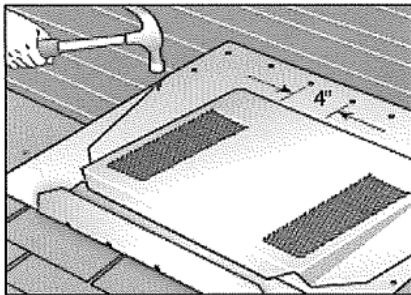

4. SECURE at 4 inch centers, using locally-approved roofing nails or screws of sufficient length to penetrate sheathing. **SEAL** all penetrations using locally-approved sealant.

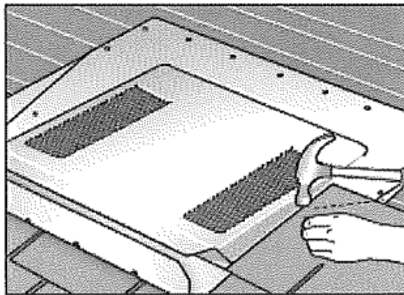

5. COVER with roofing material around vent. Based on local best practices, a 45 degree angle cut must be made on the material terminating at the vent. (See Step 5A if installing shingle-over finish method.)

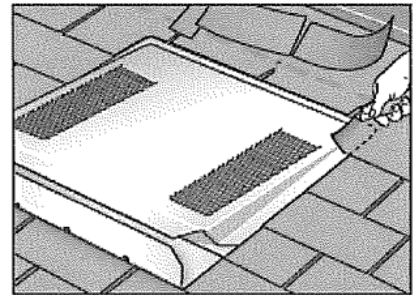

6. TRIM roofing material back 1 inch on top and sides of vent to allow for proper drainage.

END OF THIS ACCEPTANCE